


DRIVEWAY SECTION

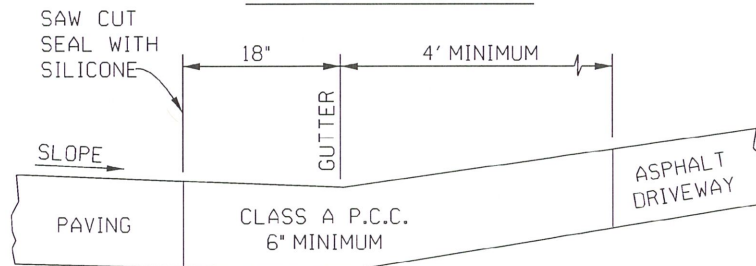

SECTION AT GUTTER

- ALL SAW CUT, EXPANSION JOINTS, AND CONTRACTION JOINTS, IN DRIVEWAY SHALL BE SEALED WITH LOW MODULUS SILICON JOINT SEALER THAT MEETS ODOT 701.08
- PROVIDE 5'X5' SIDEWALK PANEL AT DRIVEWAYS, OR EVERY 200' MAXIMUM
- MAXIMUM 24' DRIVEWAY, WIDTH GREATER THAN 24' REQUIRES APPROVAL BY THE ZONING CODE
- COMPACTION OF AGGREGATE BASE SHALL BE ACCORDING TO CITY OF TULSA STANDARD

SIDEWALKS AND RAMPS SHALL MEET THE ADA ACCESSIBILITY TECHNICAL REQUIREMENTS AS SHOWN AT WWW.ACCESS-BOARD.GOV/PROWAG/

RESIDENTIAL ASPHALT DRIVEWAY CONCRETE STREET	
CITY OF TULSA, OKLAHOMA PUBLIC WORKS DEPARTMENT	
DRAWN BY: D.J.N. CHECKED BY:	APPROVED <i>T.O.M.</i>
DATE: OCTOBER 2023	
NOT TO SCALE	STANDARD NO. 703