


PATH NAME: /E1/PARTS/STD/DCN.STDS/417-SLIPLINE-PIPE-DROP.DGN D.J.N 10/18/2023

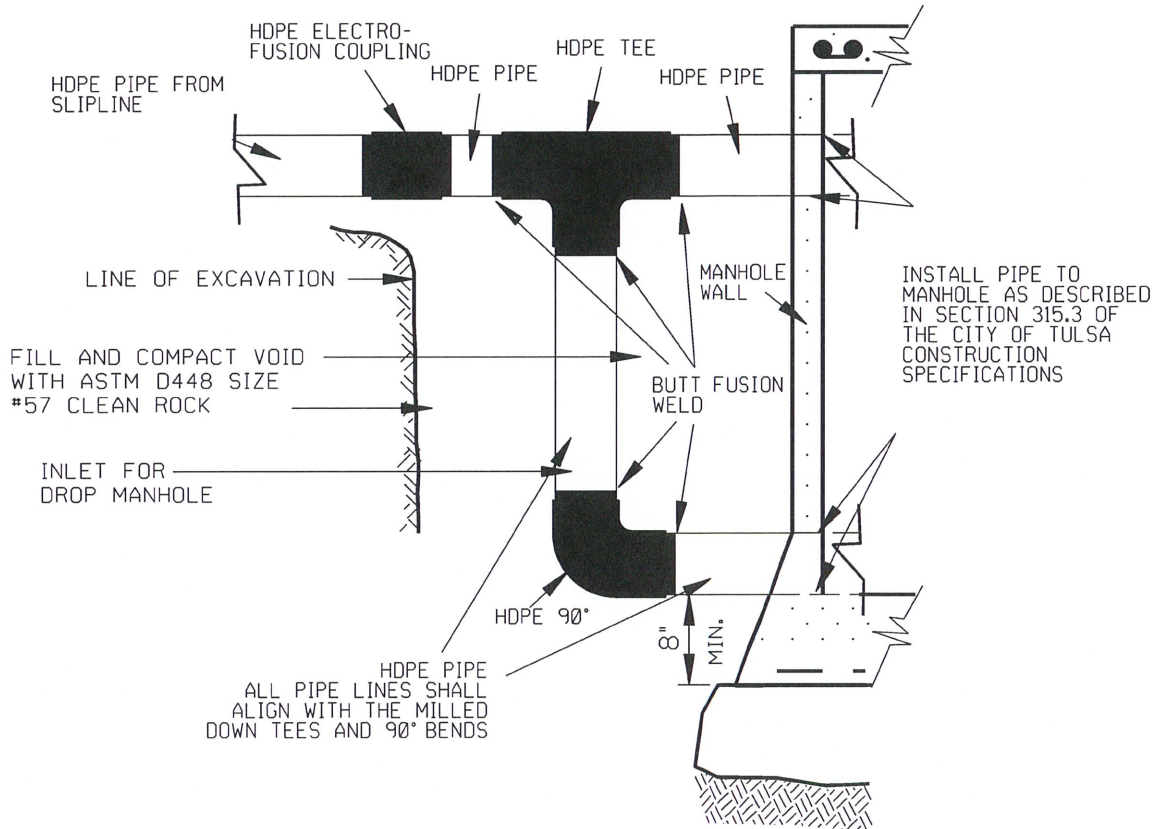


INSTALL PIPE TO MANHOLE AS DESCRIBED IN SECTION 315.3 OF THE CITY OF TULSA CONSTRUCTION SPECIFICATIONS

HDPE PIPE ALL PIPE LINES SHALL ALIGN WITH THE MILLED DOWN TEES AND 90° BENDS

NOTE:

1. HDPE TEE AND HDPE 90 FEEDSTOCK TO BE SDR7 PE4710 HDPE PIPE MEETING ASTM F714/D3035, AWWA C901/C906 WITH THE FIRST 3' OF THE OUTSIDE DIAMETER OF THE CONNECTING ENDS REDUCED TO MATCH THE OUTSIDE DIAMETER OF THE SLIPLINE PIPE, SO THAT THEY CAN BE PROPERLY FUSED.
2. HDPE ELECTRO-FUSION COUPLING TO BE MANUFACTURED BY GEORGE FISCHER CENTRAL PLASTICS BASED OUT OF SHAWNEE, OK
3. HDPE PIPE SHALL MEET SECTION 409 OF CITY STANDARD SPECIFICATIONS.

DROP DETAIL 8" HOST PIPE WITH 7.125" SLIPLINE PIPE	
CITY OF TULSA, OKLAHOMA PUBLIC WORKS DEPARTMENT	
DRAWN BY: D.J.N.	APPROVED: 
CHECKED BY:	DATE: OCT.18 2023
NOT TO SCALE	STANDARD NO. 417